

PIPING CONNECTION LOCATION OUT RIGHT SIDE OF UNIT

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 88.0 L X 34.9 W X 42.0 H.



THIRD - ANGLE PROJECTION SHEET 2 OF 3


HUSSMANN HIGH EFFICIENCY H-SERIES LARGE INDOOR STD BASE

°PD-000000006 |

INFORMATION SUBJECT TO CHANGE

MINIMUM CLEARANCE REQUIREMENTS:


ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION, AND MAY EXCEED DIMENSIONS SHOWN.

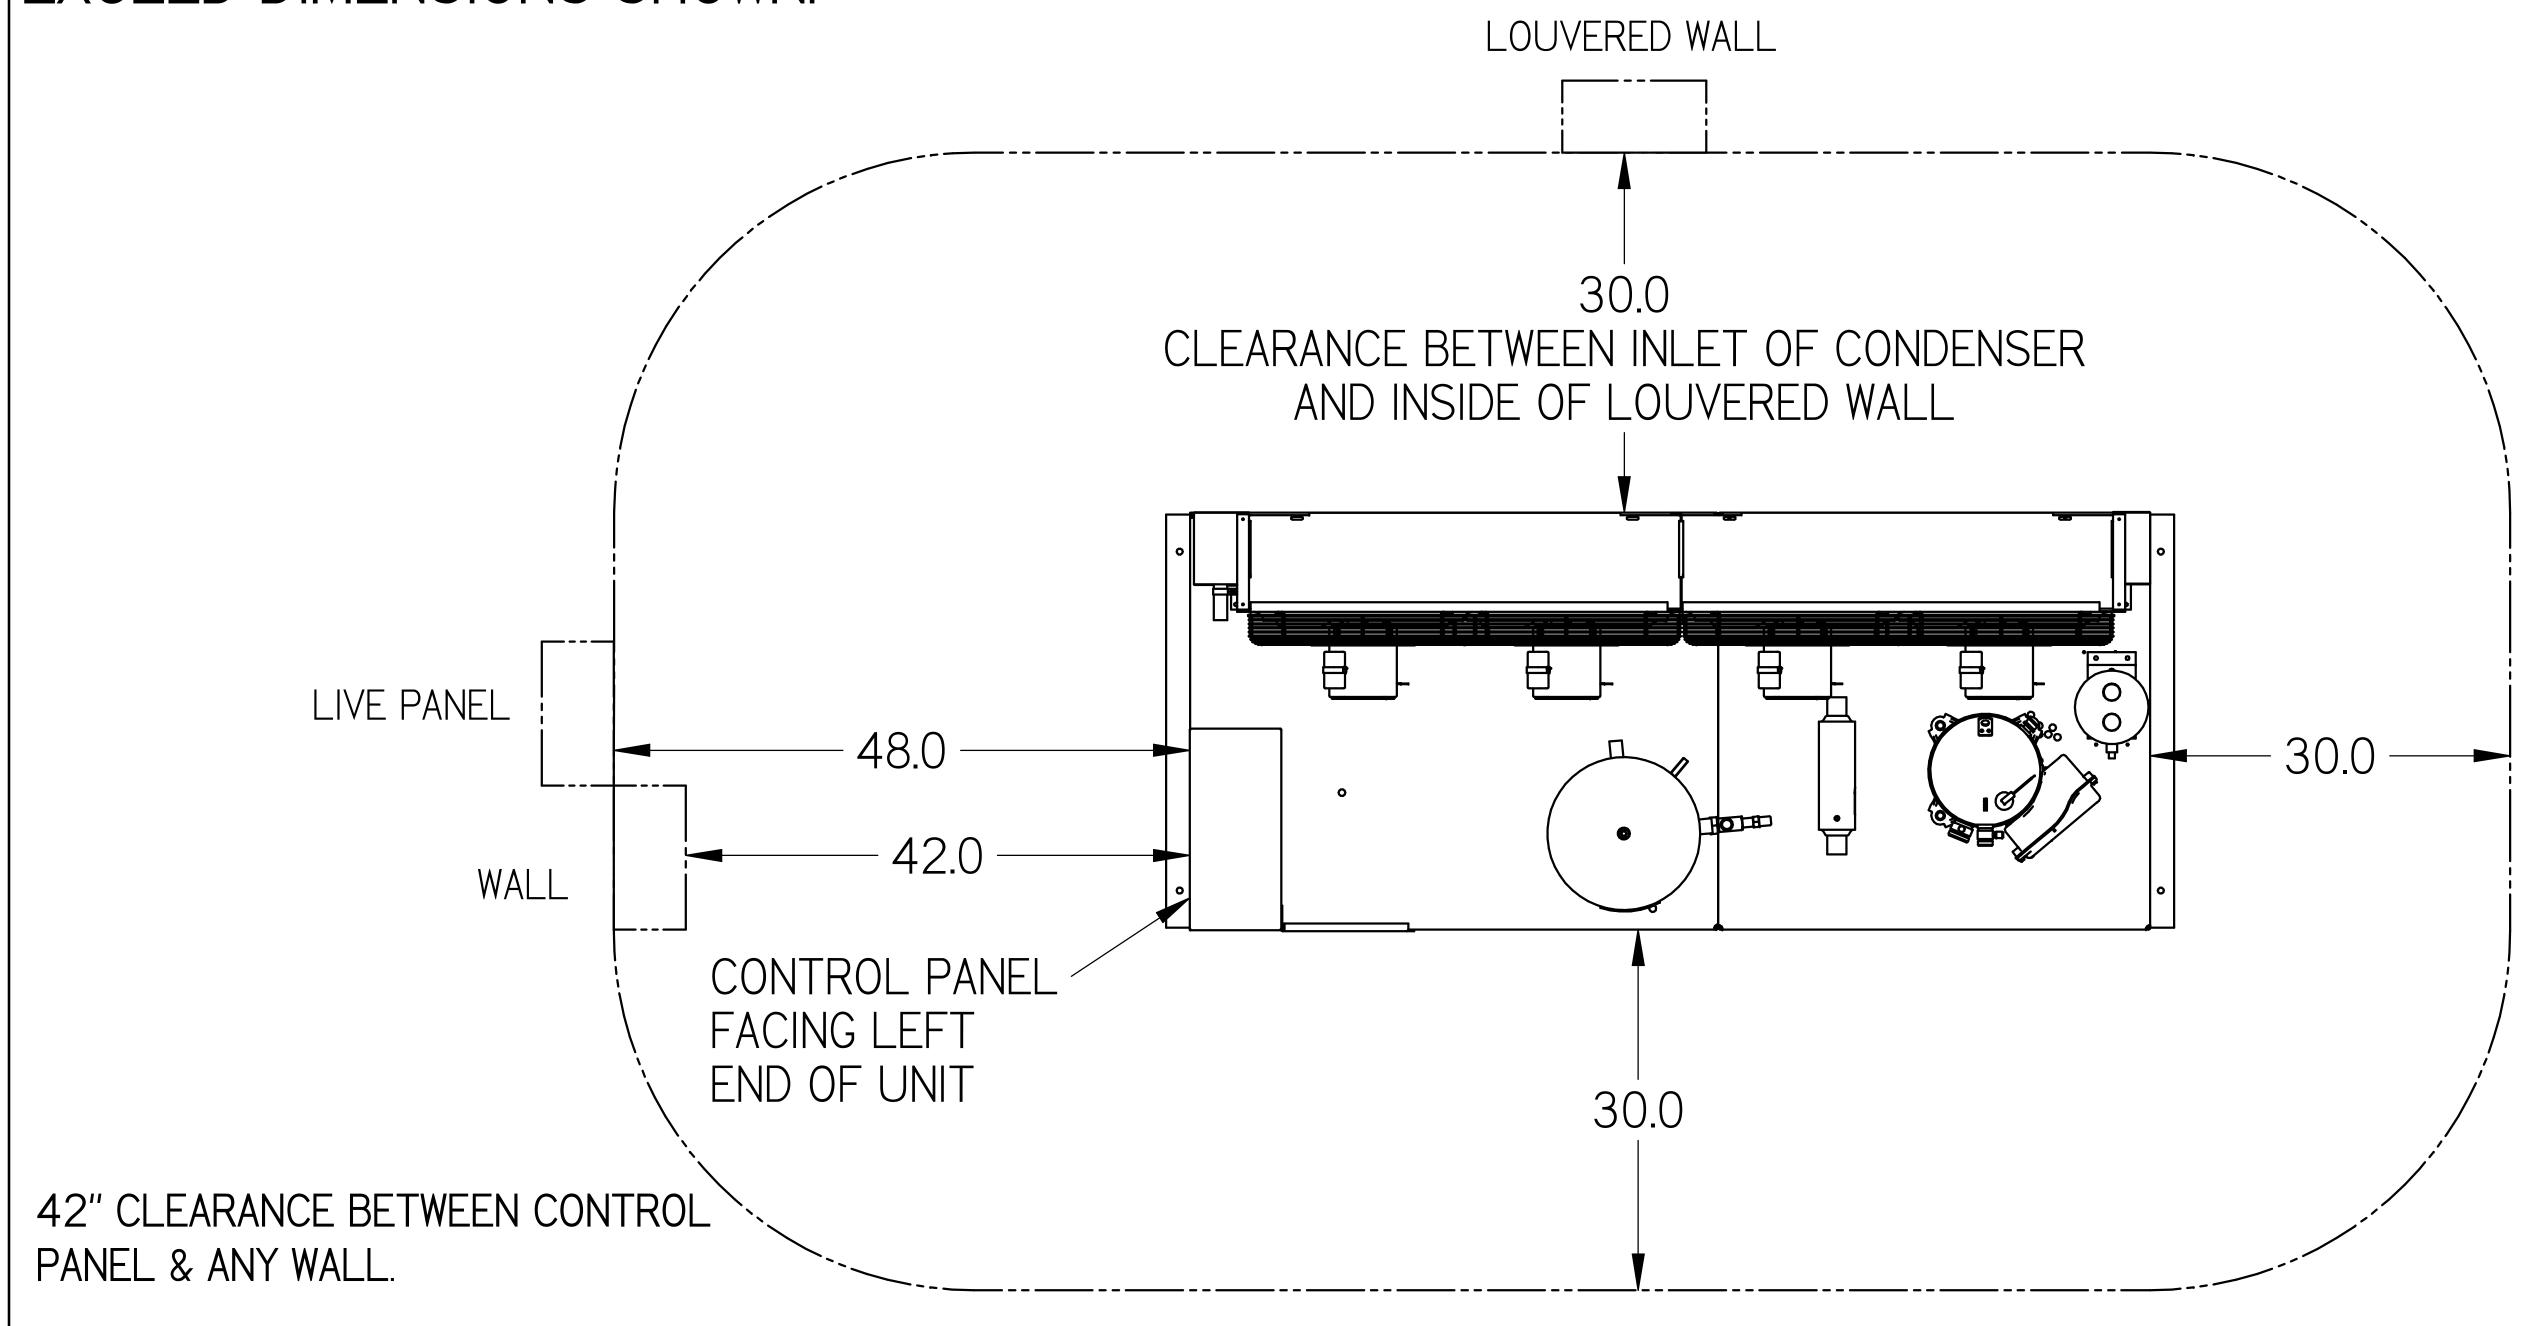


48" CLEARANCE BETWEEN CONTROL PANEL & ANY LIVE PANEL.

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 88.0 L X 34.9 W X 42.0 H.



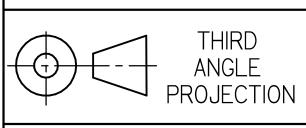

HUSSMANN
HIGH EFFICIENCY
H-SERIES LARGE
INDOOR STD BASE

PD-000000006 | REV

INFORMATION SUBJECT TO CHANGE