



HIGH EFFICIENCY H-SERIES EXTRA LARGE SIZE INDOOR UNIT STANDARD BASE "HxSx-xxxxxxxx-xx-x" WEIGHT: 1,575 LBS.

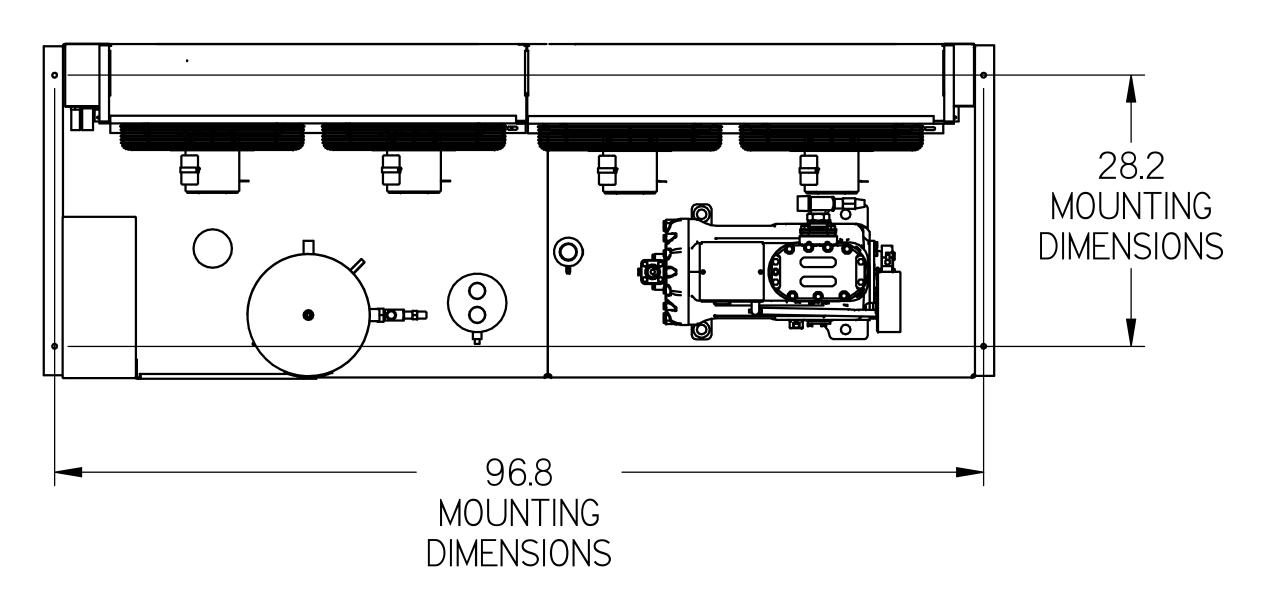

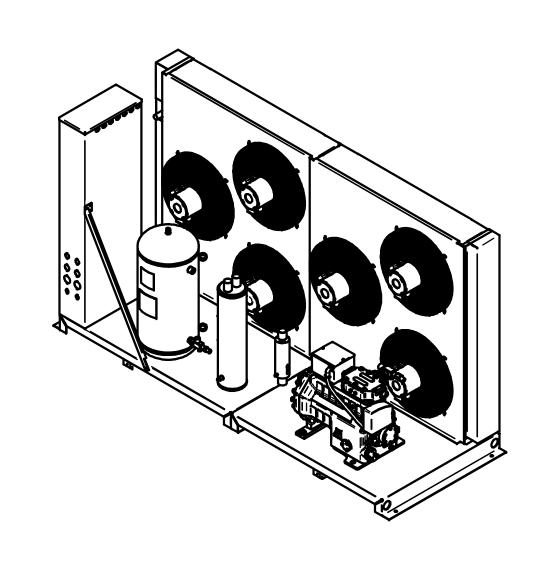

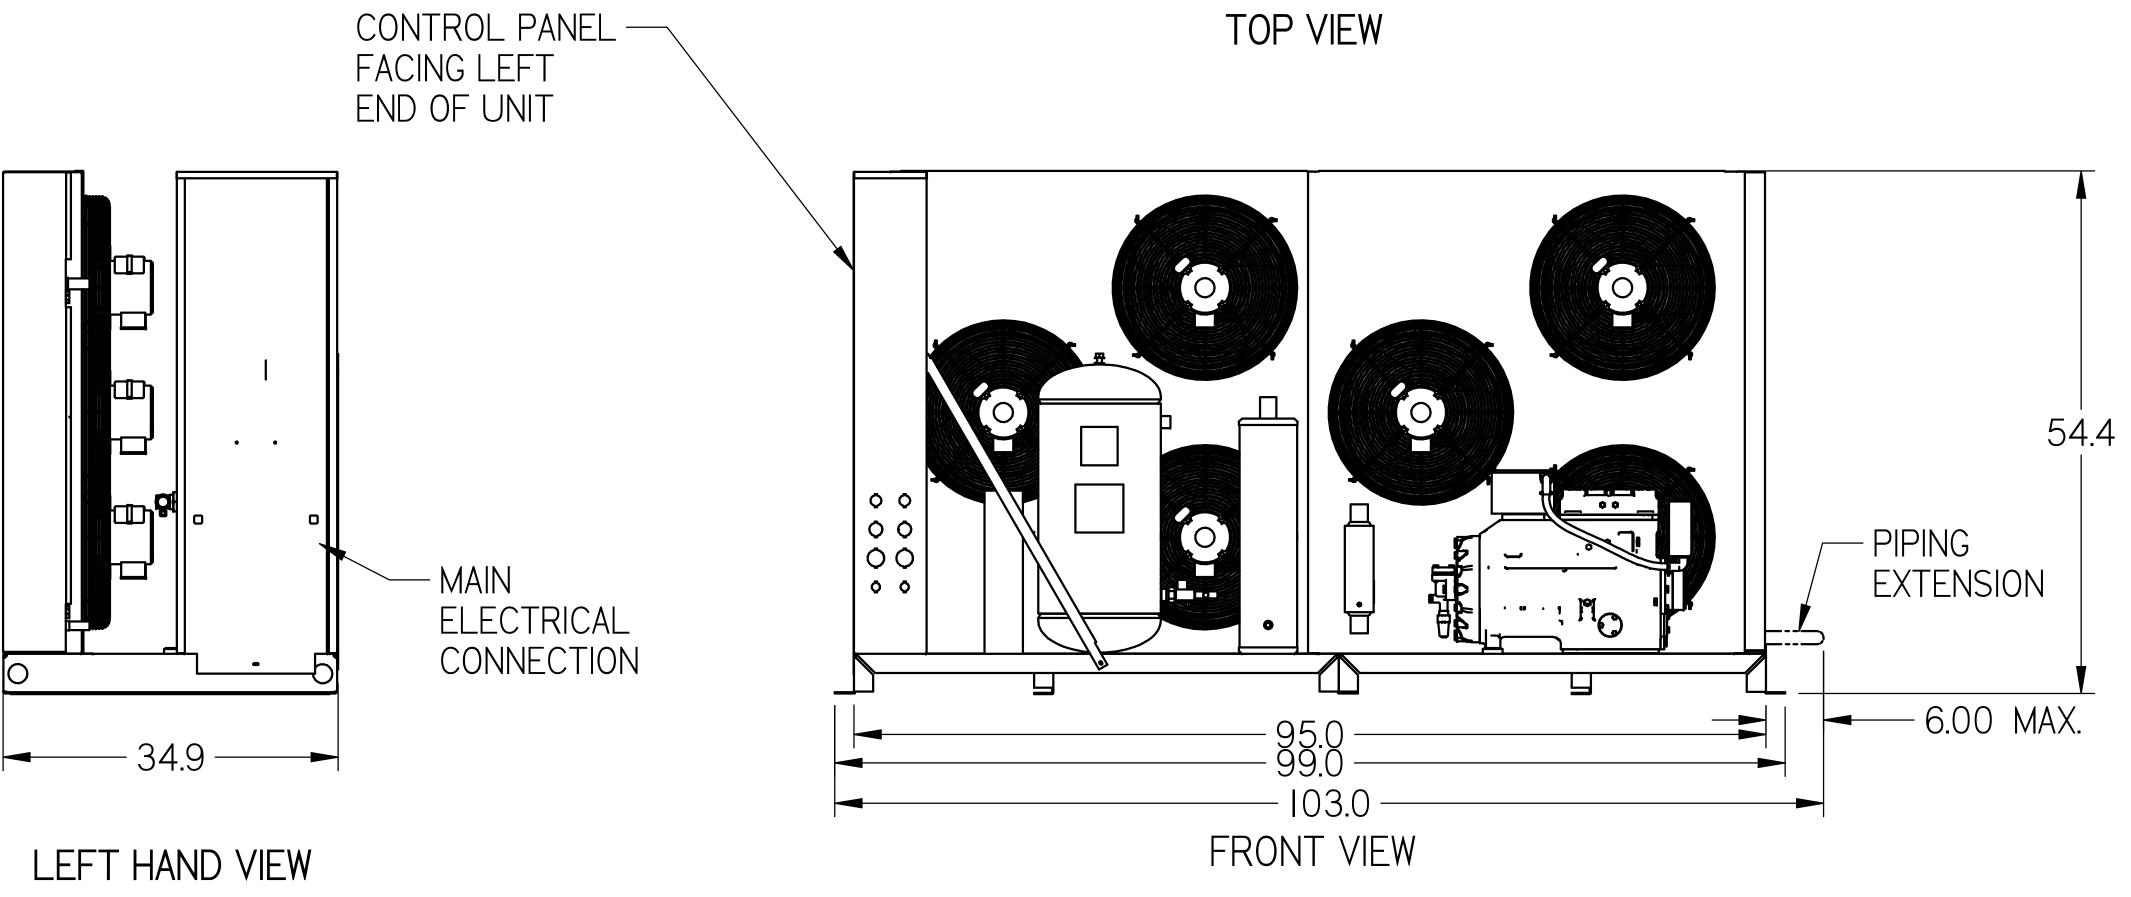

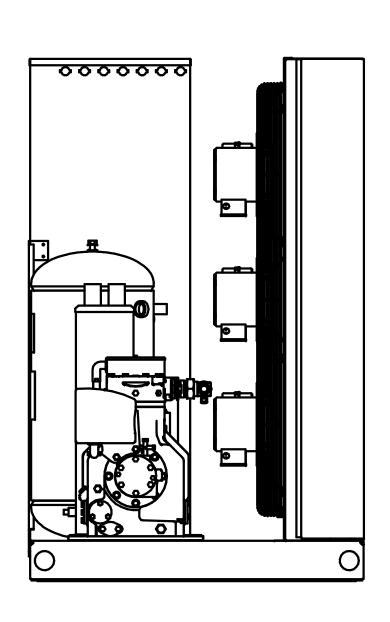

RIGHT SIDE VIEW

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 103.0 L X 34.9 W X 54.4 H.

DIMENSIONS ARE IN INCHES DRAWN: DEC 2019

SHEET I OF 3


ANGLE PROJECTION

HUSSMANN HIGH EFFICIENCY H-SERIES EXTRA LARGE

INDOOR STD BASE

PD-00000007


INFORMATION SUBJECT TO CHANGE

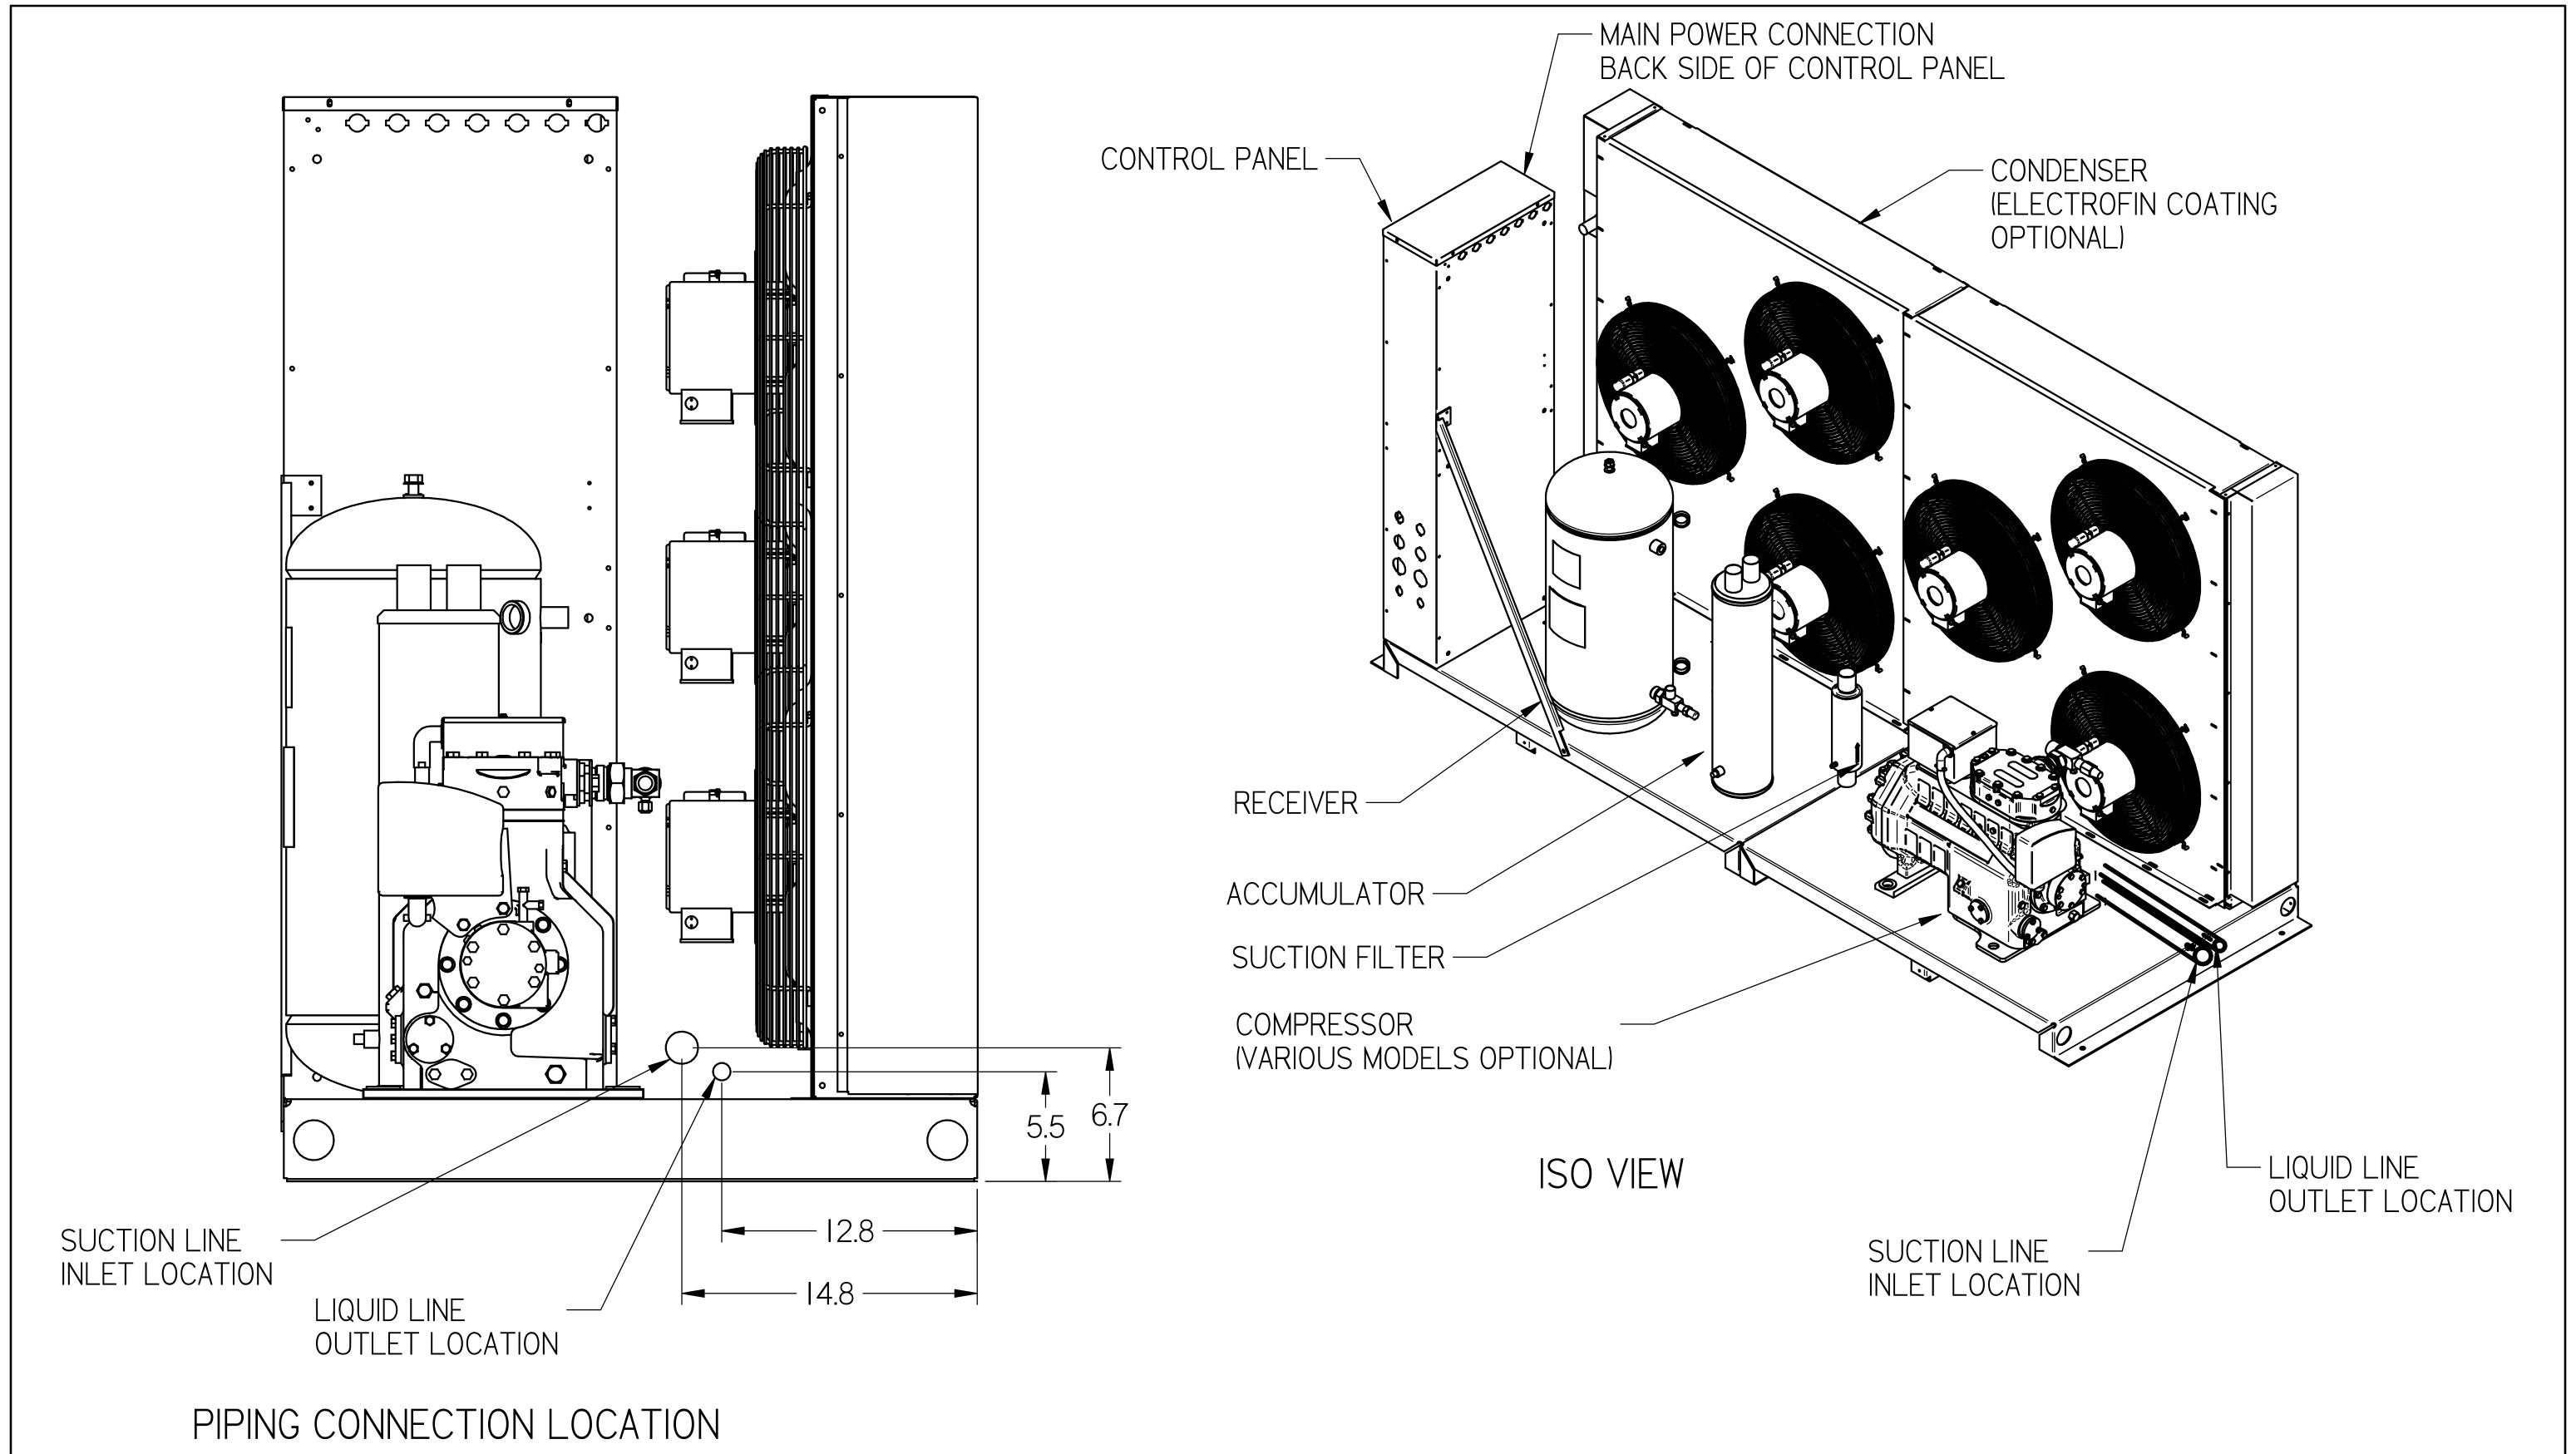

OUT RIGHT SIDE OF UNIT

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 103.0 L X 34.9 W X 54.4 H.



HUSSMANN HIGH EFFICIENCY

THIRD - ANGLE PROJECTION SHEET 2 OF 3

INFORMATION SUBJECT TO CHANGE

H-SERIES EXTRA LARGE INDOOR STD BASE

PD-00000007

MINIMUM CLEARANCE REQUIREMENTS:

ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION, AND MAY

EXCEED DIMENSIONS SHOWN. LOUVERED WALL 30.00 CLEARANCE BETWEEN INLET OF CONDENSER AND INSIDE OF LOUVERED WALL LIVE PANEL 48.0 30.0 42.0 WALL

CONTROL PANEL

FACING LEFT

END OF UNIT

42" CLEARANCE BETWEEN CONTROL PANEL & ANY WALL.

48" CLEARANCE BETWEEN CONTROL PANEL & ANY LIVE PANEL.

NOTES:

I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.

2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.

3. OVERALL DIMENSIONS: 103.0 L X 34.9 W X 54.4 H.

DIMENSIONS ARE IN INCHES DRAWN: DEC 2019

ANGLE PROJECTION

HIGH EFFICIENCY H-SERIES EXTRA LARGE INDOOR STD BASE

HUSSMANN

INFORMATION SUBJECT TO CHANGE

30.0

PD-00000007