

OUT RIGHT SIDE OF UNIT

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.
- 3. OVERALL DIMENSIONS: 52.0 L X 35.0 W X 42.0 H.




HIGH EFFICIENCY H-SERIES MEDIUM OUTDOOR STD BASE


°PD-000000014|°

INFORMATION SUBJECT TO CHANGE

SHEET 2 OF 3

MINIMUM CLEARANCE REQUIREMENTS: ACTUAL CLEARANCE REQUIREMENTS ARE DEPENDENT UPON AUTHORITY HAVING JURISDICTION, AND MAY EXCEED DIMENSIONS SHOWN.

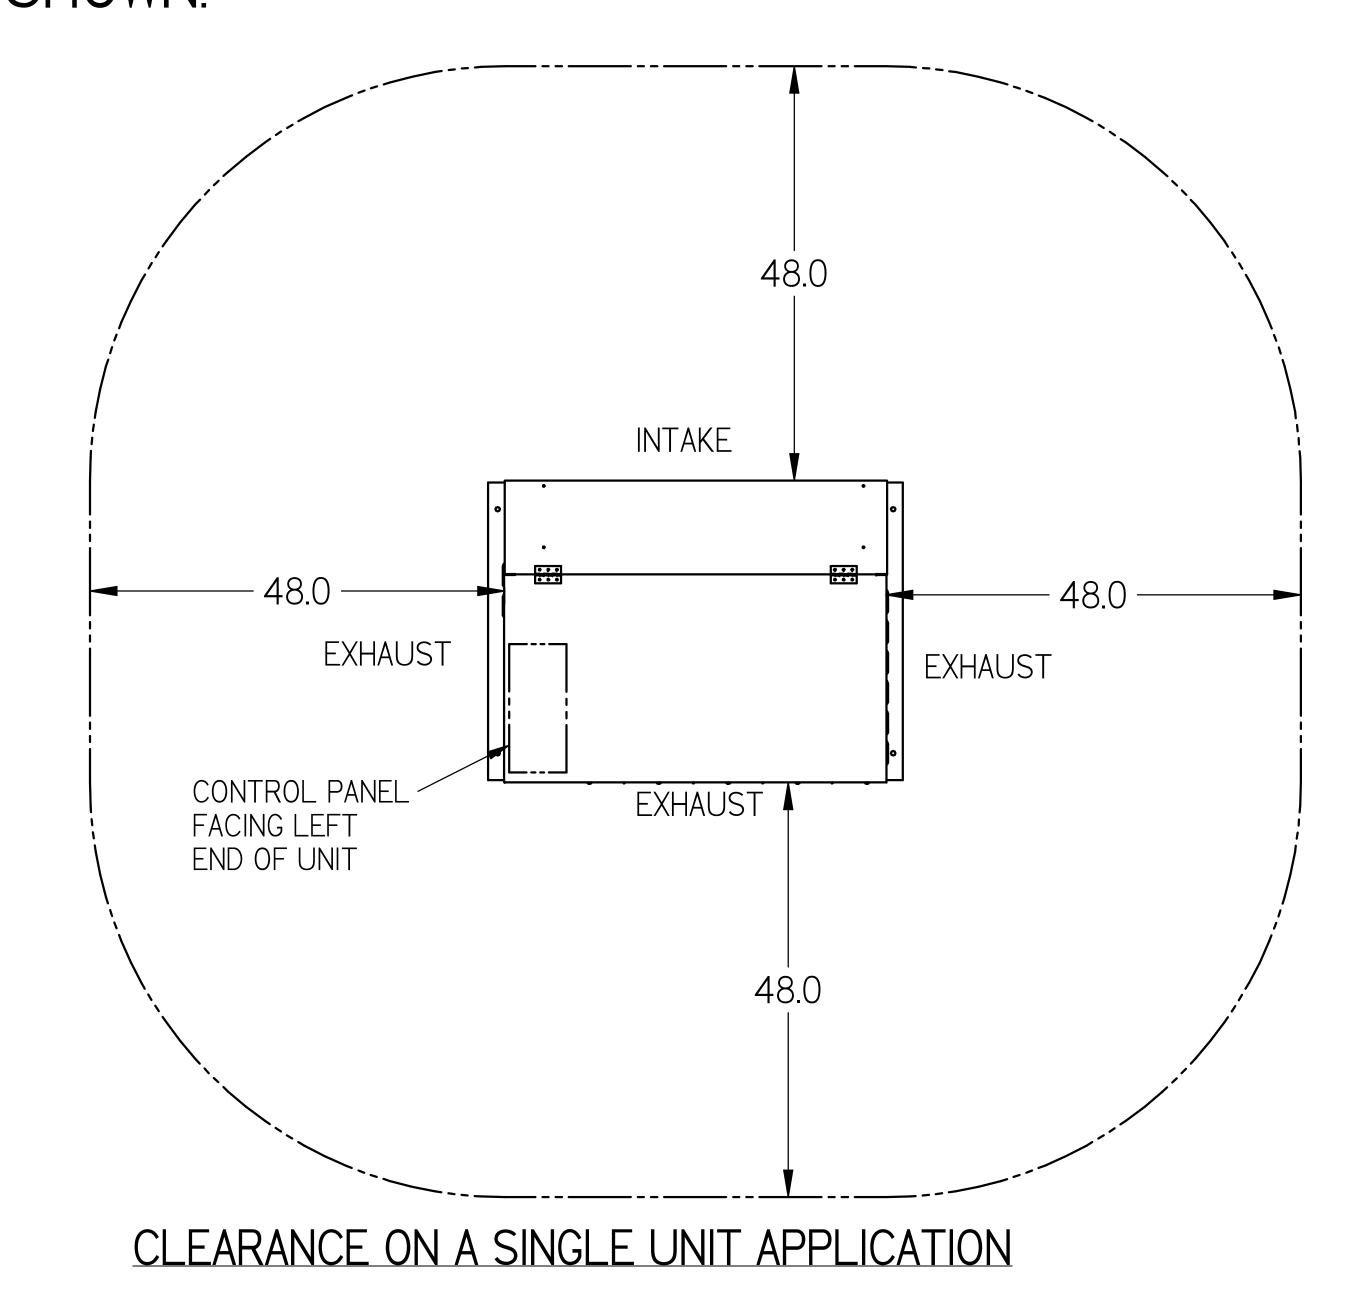


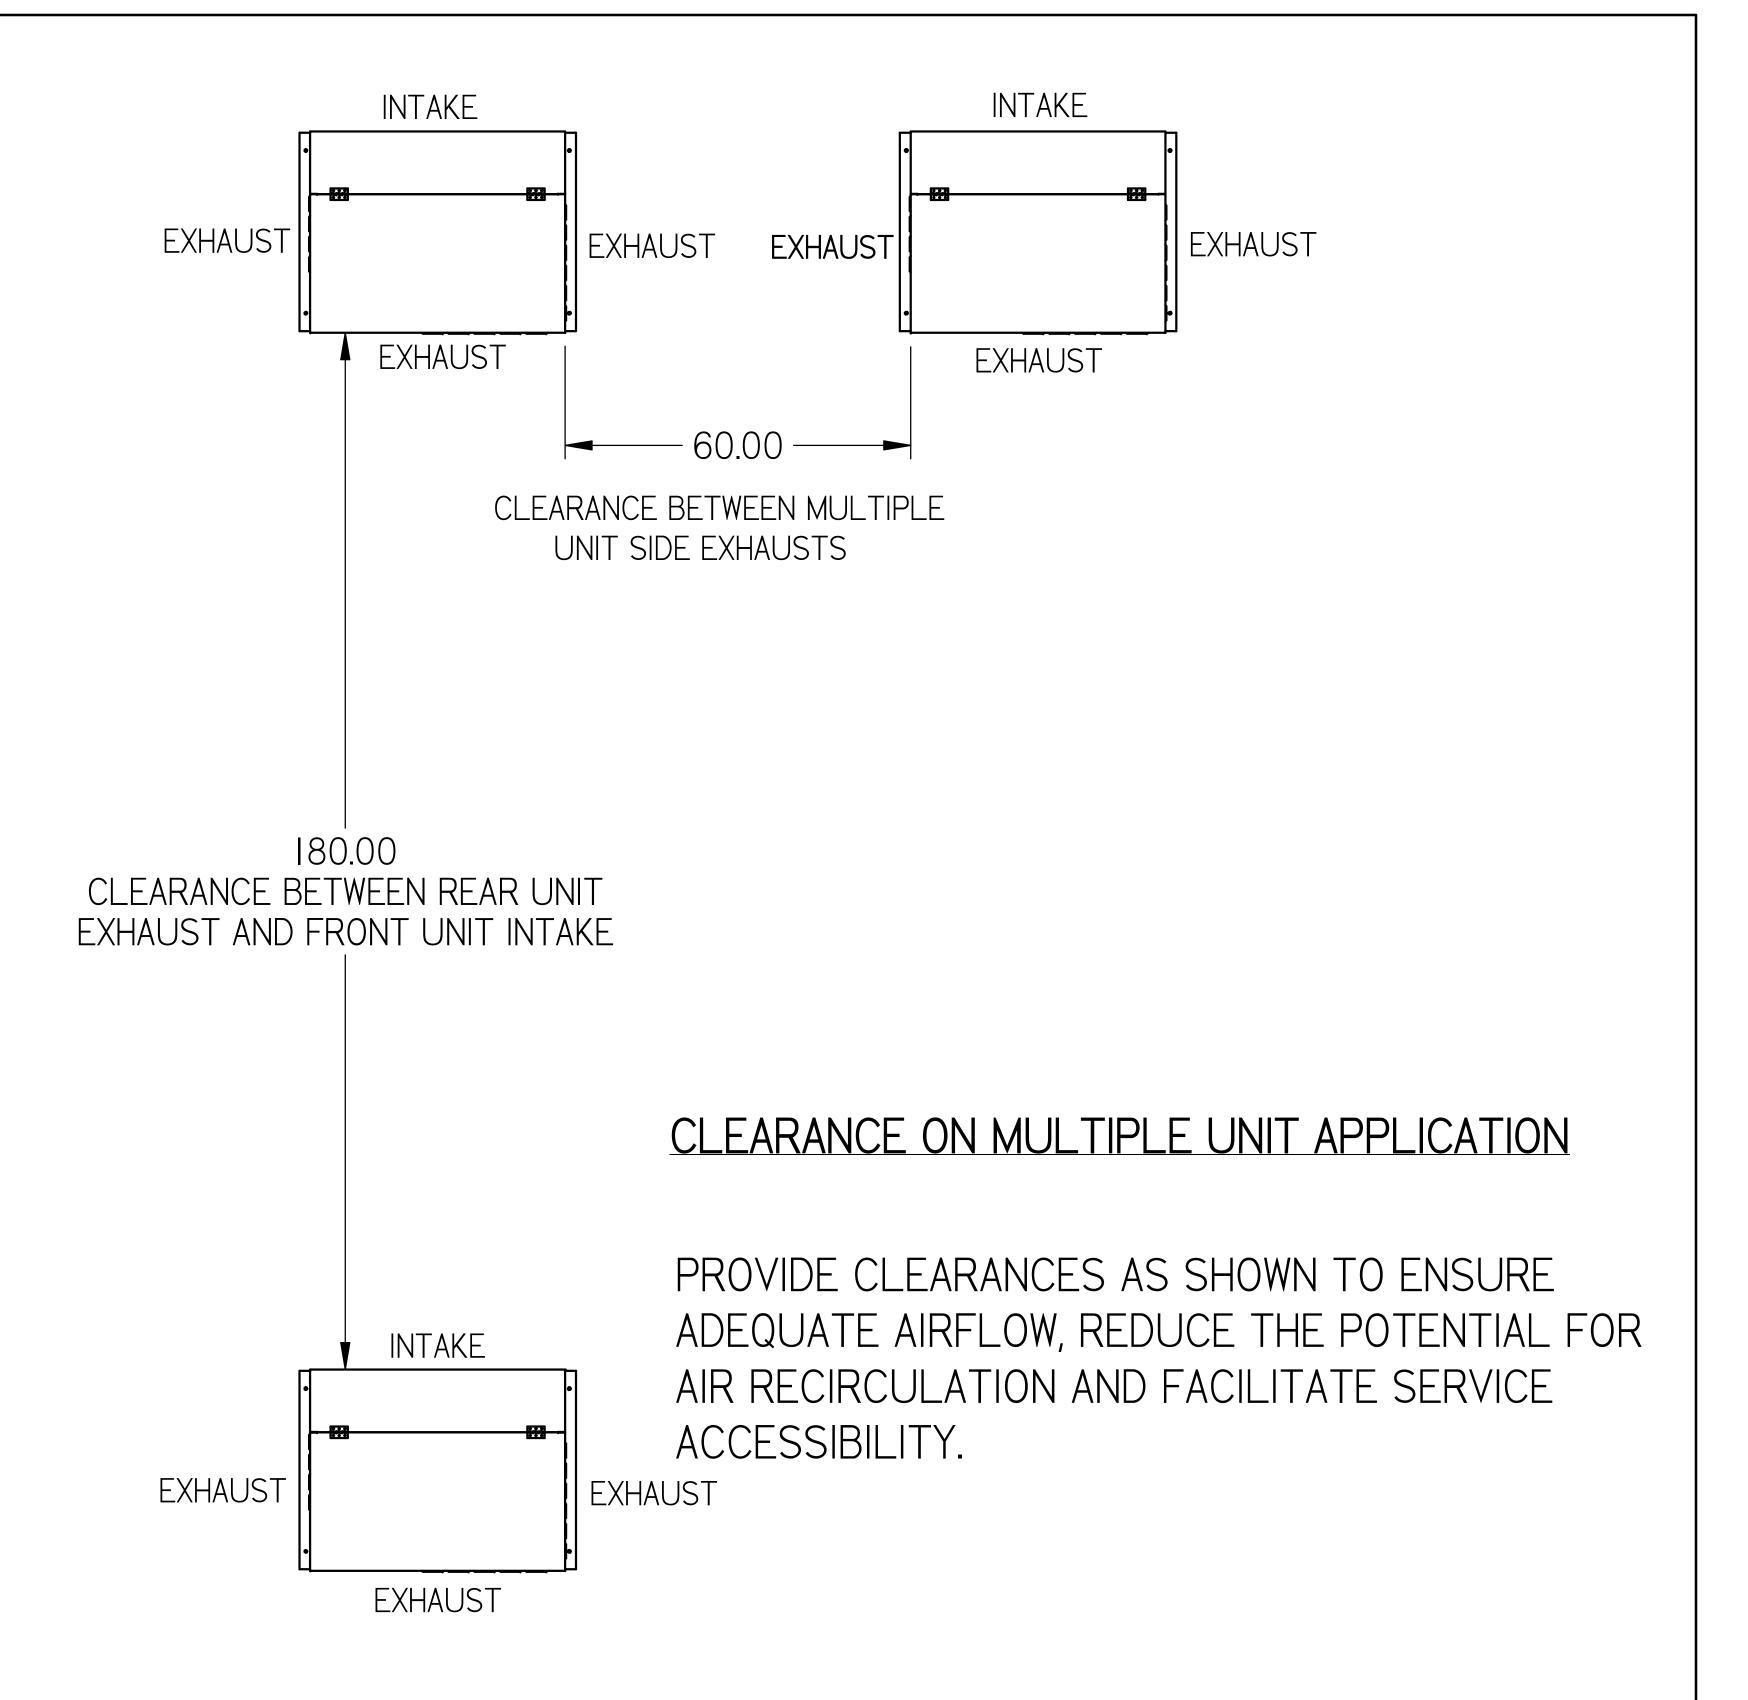

NOTES:

- I. IT IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR TO ENSURE THAT THE FINAL EQUIPMENT INSTALLATION MEETS ALL APPLICABLE CODE REQUIREMENTS.
- 2. ILLUSTRATION SHOWN IS FOR GENERAL REPRESENTATION ONLY. ACTUAL PRODUCT WILL VARY DEPENDENT UPON APPLICATION.

3. OVERALL DIMENSIONS: 52.0 L X 35.0 W X 42.0 H.

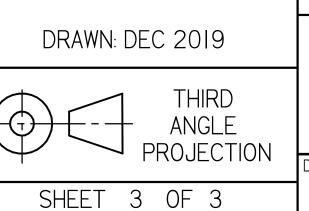

DIMENSIONS ARE IN INCHES

HUSSMANN

HIGH EFFICIENCY
H-SERIES MEDIUM
OUTDOOR STD BASE

PD-00000014 REV

INFORMATION SUBJECT TO CHANGE